

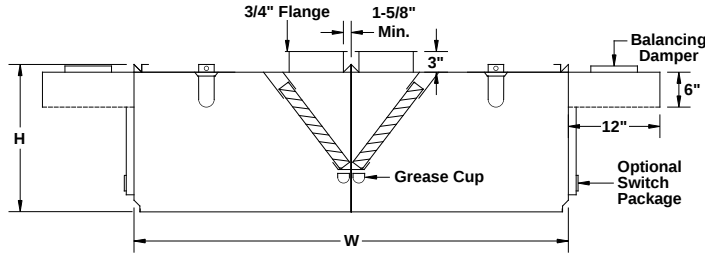




MODEL KB-FS WITH FRONT SUPPLY PLENUM




NSF Approved
Bottom Edges
On Front



**BRACKET
DETAIL**

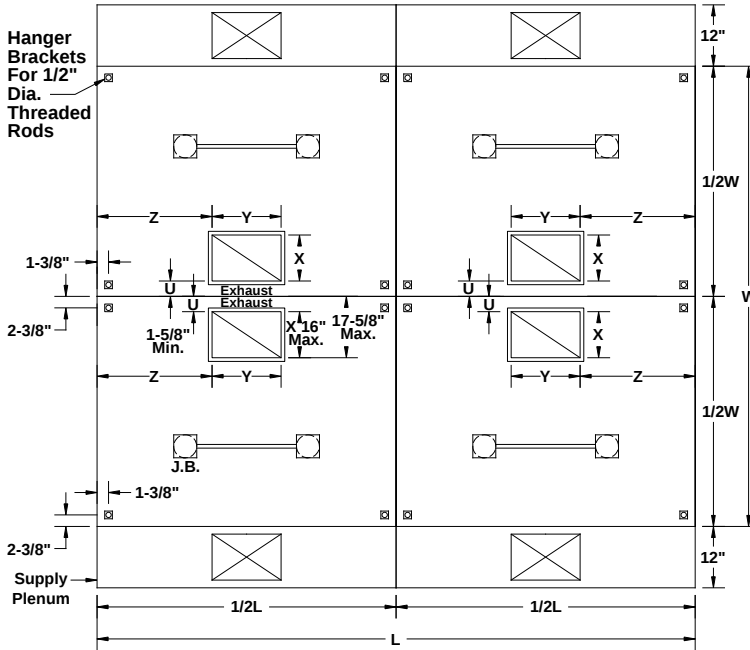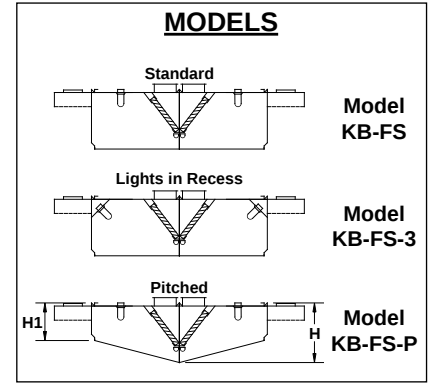

**Hanger Brackets
For 1/2\"/>**

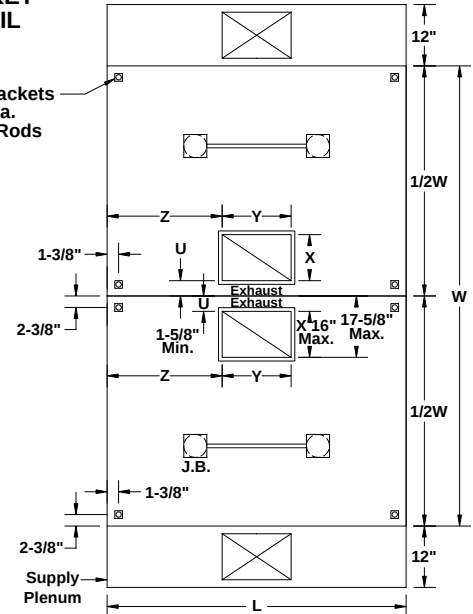

Quantity	Model	① Material	② Gauge	Hood Dimensions			③ Number of Lights	Bottom Edge Type
				L	W	H		
④ Factory Cut Exhaust Opening				⑤ Filters				
U	X	Y	Z	Type	Material	Quantity	Size	⑥ Finish
								⑦ Side Skirts
								Other Options
								Tag

- ① Type 304 or 430 stainless steel.
- ② 18 ga. is standard; other gauges available.
- ③ Standard is 100 watt vapor proof incandescent U.L. Listed for use on grease exhaust hood.
- ④ 2 sets of collars required on hood sections over 12' long.
- ⑤ Aluminum baffle type U.L. Classified filters standard.



Intertek

- ☐ Without Exhaust Fire Damper
☐ With Exhaust Fire Damper

- ⑥ #3 polish standard.
- ⑦ Advise if one or both sides. Make a sketch.
- ⑧ Optional exhaust air fire damper.
- ⑨ Standard supply air collar balancing damper.
- ⑩ Optional switch package with surface mounted stainless steel cover and junction box on top of hood. (Fan switch with illuminated toggle).
☐ Hood mounted ☐ Loose for wall mounting
Number of light switches _____
Number of fan switches _____ Voltage _____ 115V _____ 24V



To maintain our policy of continuous product development, we reserve the right to change prices, specifications, ratings and dimensions without notice or obligation.

Project		Location	
Engineer		Dwg. No.	SD-KB-FS
Architect		Date	12/17
Contractor			



KEES INCORPORATED
400 S. Industrial Dr.
Elkhart Lake, WI 53020
Phone: (920) 876-3391
Fax: (920) 876-3065
Website: www.kees.com